



**AGRICULTURAL COOPERATIVES**

# **DUVADZI YOUTH COOPERATIVE**



GIYANI LOCAL SCALE CLIMATE  
RESILIENCE PROGRAMME



*Technical designs for Local Multiple Use  
Systems.*

*Duvadzi Agricultural Cooperative water  
supply*

March 2023

## Acknowledgements

We gratefully acknowledge the funding and support for the programme entitled Adaptive response and local scale adaptation for improving water security and increasing resilience to climate change in selected communities in Giyani, Limpopo. The programme is funded by the Government of Flanders, managed by the Water Research Commission and implemented by Tsogang Water and Sanitation, Association for Water and Rural Development (AWARD), University of the Western Cape (UWC) and the WRC's TTO Enterprise Development.



### DISCLAIMER

The content of this handbook does not necessarily reflect the views and policies of the WRC or its partners, nor does mention of trade names or commercial products constitute endorsement or recommendation for use. The WRC and partners cannot be held liable in any way for the damage, personal harm or any breakdowns stemming from actions related to the contents of this handbook.

March 2023



## Table of Contents

Technical designs for Local Multiple Use Systems.....	2
Duvadzi Agricultural Cooperative water supply .....	2
Acknowledgements .....	3
The Giyani Local Scale Climate Resilience Programme (GLSCRП) .....	1
About this Technical Design document .....	2
Who is the Technical Design document for? .....	2
What does the Technical Design document contain? .....	2
How to use the Technical Design Document? .....	2
1 Duvadzi youth organic agricultural cooperative intervention summary .....	5
Background .....	5
Intervention Content .....	5
Water source quality for the GLSCRП Project sites .....	6
Water Sources for the GLSCRП project sites .....	8
Groundwater sample analyses for all water sources .....	9
Agricultural Cooperative Water Supply Drawings:.....	13

# The Giyani Local Scale Climate Resilience Programme (GLSCRCP)

The Giyani Local Scale Climate Resilience Programme (GLSCRCP) aims to develop and implement activities that will research, develop and demonstrate climate adaptive responses and solutions for optimising water utilisation in drought-stricken areas. The programme will focus on the Greater Giyani Municipal area within the Mopani district and aims to impact an estimated 5000 beneficiaries over a three-year period in terms of water utilisation, improved water mix, and socio-economic opportunities as responses to climate adaptation. A 2019 WRC study on droughts and adaptation strategies has highlighted risks to reduced productivity, livelihoods and food security, and an increase in vector and water-borne diseases in communities such as Giyani. Ultimately, climate change impacts on water resources in the Giyani area cannot be underestimated.

The programme has three key areas that will support for improving local scale adaptation and resilience in Giyani. They are:

- 1) a strengthened enabling environment whereby local authorities, institutions, communities, traditional authorities and market players are mobilised to improve climate resilience and water utilisation;
- 2) improved energy, ground and surface water solutions developed with communities to optimise and diversify water sources;
- 3) activities that support livelihoods and local economic development opportunities.

The programme will cover a spectrum of rural and rural residential areas in Giyani, working closely with the Mopani District Municipality and the Greater Giyani Local Municipality. Implementation partners include Tsogang Water and Sanitation as the lead on water projects and infrastructure; Association for Water and Rural Development (AWARD) in support of capacity development and stakeholder engagement, University of the Western Cape (UWC) as the water and energy technical partner and the WRC's TTO Enterprise Development arm on social enterprise development supporting local economic development projects.



# About this Technical Design document

This technical Design document consist of a summary of all 5 sites of the Agricultural Cooperative project. Technical designs for the infrastructure interventions are also outline in this technical design document.

## Who is the Technical Design document for?

This technical design document is meant for the Agriculture Cooperative members, Department of Agriculture and the Mopani District Municipality as the Water Service Authority.

## What does the Technical Design document contain?

In this technical design document, we share important information on the type of innervations each project site received. We also share the technical designs for the infrastructure that was installed at each project site.

## How to use the Technical Design Document?

The Agriculture Cooperative members will use the document for maintenance. The Department of Agriculture and the District Municipality will use the document to provide support to the agriculture cooperative in terms procuring more infrastructure and also to have in-depth knowledge of off grid water and alternative water source.

# Technical Designs for Agricultural Cooperative

The feasibility and design of the systems at each pilot site was refined in more detail based on the following aspects:

1. The original feasibility study conducted in WRC project No. C2020.2021-00718 (Jovanovic et al., 2021)
2. More specific coordinates, elevations measured at key points during the field campaign on 14-19 May 2022; further discussions with stakeholders that took place during the same field campaign
3. Technical information (static rest water levels and required pressure heads; water requirements pipeline layout, pipe diameter, installation and size of tanks; installation of booster pumps to secure enough water pressure is delivered)

The main method for the refinement of MUS technical design at pilot sites was the adapted Toolbox for Solar Powered Irrigation Systems (SPIS) (GIZ and FAO, 2021) and field measurements. Further refinement is possible once equipment specification and availability on the market from suppliers and manufacturers is known, as well as specific borehole characteristics and pumping tests. In particular, for the drinking water sources, the final work designs will consider the water treatment plant packages and the need for pressure booster pumps for water delivery to the distribution and storage systems. It should be noted that, for all sites, water meters will have to be installed at the point of abstraction and at the point of use, so that the efficiency of the distribution system can be assessed during performance evaluation, e.g. leakages and losses of water.

*The following table describe the description and intervention for each agricultural cooperative projects:*

Agricultural Co-operative	Interventions
<b>Duvadzi Youth Organic Agricultural Cooperative</b>	<b>1. Hybrid Solar System installed:</b> <i>This innovation integrates grid-supply with solar power for the purposes of powering local groundwater supply systems. The innovation provides relief from grid load shedding and allows for cheaper access to water for rural villages.</i>
	<b>2. Security of Hybrid Solar System installed:</b> <i>Theft and vandalism can be problematic. The project installed barbed fencing and alarm systems to protect investments.</i>
	<b>3. Water Storage installed:</b> <i>Water storage provides both pressure for driving reticulated water as well as continued supply when the solar powered pumps are not functioning.</i>

	<p><b>4. Borehole testing, equipping and skills development:</b> All boreholes where tested for water quality and equipped with a suitable pump for the system. In all cases beneficiaries where trained to understand water quality monitoring procedures.</p>
	<p><b>5. Drip irrigation system installed:</b> In this project 1 hectare of drip irrigation was installed to improve water use efficiency and support food production by the co-operative</p>

*Table 1: Duvadzi Agricultural Cooperative Water Supply project sites and GLSCR intervention*



# 1 Duvadzi youth organic agricultural cooperative intervention summary

## Background

Duvadzi is an emerging farmers' cooperative with a calculated water requirement of 33.9 m<sup>3</sup> d<sup>-1</sup> or 12,374 m<sup>3</sup> a<sup>-1</sup> for the irrigation of three vegetable crops per year (e.g. tomatoes) on 0.5 ha. The water supply is from borehole No. H14-1702, alternatively directly from the Molototsi sand river bed, which is adjacent to the farm. There are other two optional boreholes that were established by the Department of Water and Sanitation (H14- 1701 and H14-1703). The total area of arable land on the farm is about 5 ha.

## Intervention Content

The need was to install a solar-powered groundwater pump and a storage tank for agricultural water use. Providing additional distribution pipes and drip-irrigation lines is desirable, so that a water distribution network can be established from the water tank across the farm. The pump and accompanying solar panels array is installed at borehole H14-1702, which is located adjacent to a draining gully (elevation is 392 m). The groundwater quality is marginally fit for agriculture due to the elevated EC (predominantly NaCl). Water treatment is not required, however the salinity levels in the groundwater and soil will have to be monitored to prevent any risk of salinization. A common filter for agricultural water will be required. A reservoir was installed in the North-West portion of the farm (100 m<sup>3</sup>, about 2 m high), at the point of the highest elevation (398 m), to buffer the water demand. The distance between the abstraction point and the planned location of the tank is about 320 m, which implied some earth works to bury a 75 mm conveyance pipeline. Given that a drip-irrigation system would require a total pressure of about 3 b (30 m) to deliver water at a pressure of 1 b (10 m) at the emitter points, a pressure booster pump is installed from the reservoir to the delivery system.

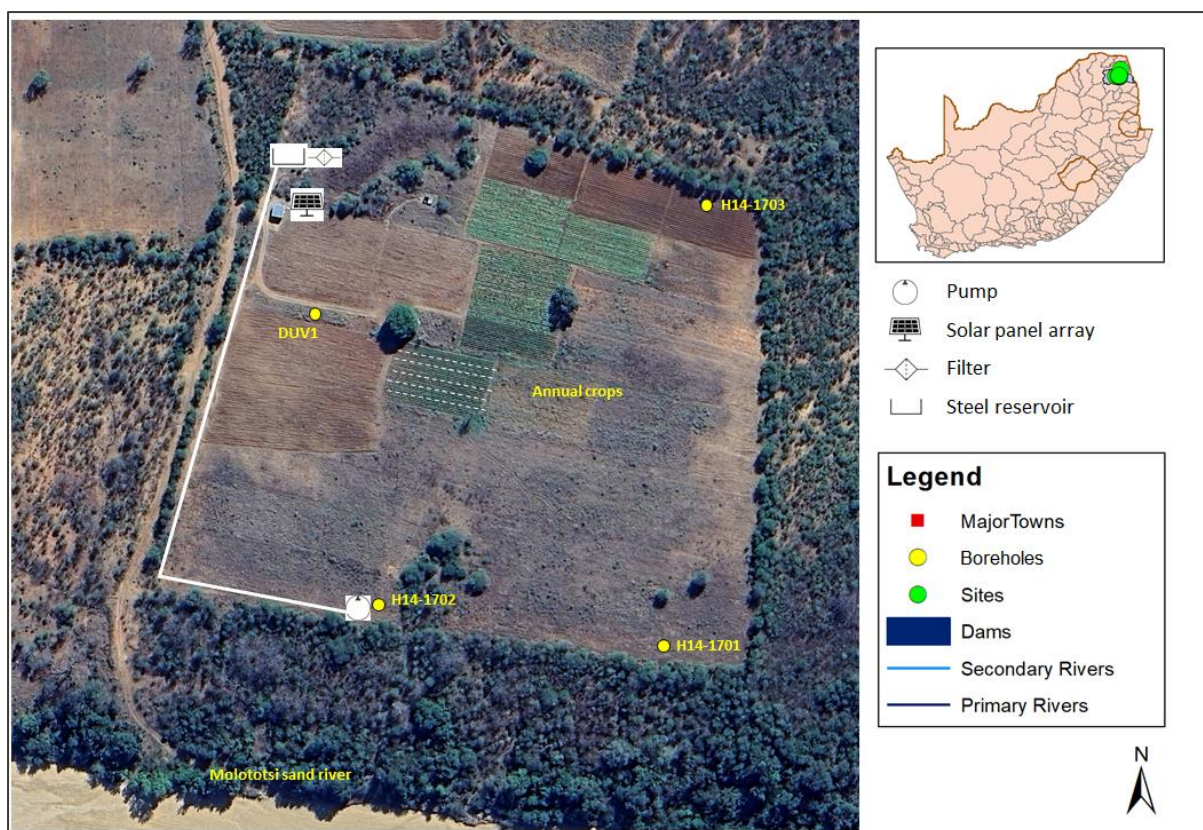


Figure 4: Top: Duvadzi Youth Organic Agricultural Cooperative. Bottom: Final installation scheme of solar-powered groundwater pump for irrigation (background is Google Earth image).

## Water source quality for the GLSCR Project sites

The need was to install a solar-powered groundwater pump for agricultural water use at borehole No. 2. In addition, a pressure booster pump was installed to deliver water from the reservoir to the fields at enough pressure for sprinkler irrigation, usually operating at 2-3 bars. Providing additional distribution pipes and drip-irrigation lines is desirable, so that a water distribution network can be established from the water tank across the farm. The pump and accompanying solar panels array will be installed at borehole No. 2 (elevation is 447 m) that will pump water to the concrete reservoir (elevation is 457 m). The groundwater quality is fit for agriculture with elevated  $\text{NO}_3$ , which can be seen as an additional supplement of nutrients. Water treatment is therefore not required, however an ordinary filter for agricultural water will be required.

Groundwater samples were collected during a field campaign on 26-31 October 2022 and collection of the samples is a continuous process in all the water sources. The samples were collected at the water sources according to standard procedures in 0.25 L plastic bottles, for chemical analyses in the laboratory. Water sources at all 9 pilot sites were sampled, except at Matsotsosela where borehole H14-0025 dried up and the pump at the currently operating borehole H14-1724 could not be started. The samples were kept in a cooler box with ice bricks, and sent to the Central

Analytical Facility (CAF) of Stellenbosch University for laboratory analyses. The following physical and chemical parameters were analysed:

- Physical parameters: electrical conductivity (EC), total dissolved solids (TDS) and colour (Hazen)
- pH and total organic carbon (TOC)
- Anions: F, Cl, SO<sub>4</sub>, NO<sub>2</sub>, NO<sub>3</sub>, Br
- Cations: Li, Na, Ca, Mg, K, NH<sub>4</sub>
- Heavy metals: Al, Mn, Fe, Cu, Cd, Zn

All the results are presented in the tables below and they were compared to the South African National Standard SANS 241 of 2015 to determine the water quality fitness for domestic use. The figures in red in the tables indicates values of determinants that are not within the SANS 241 thresholds. For comparative purposes, the analyses of samples collected in the previous sampling campaign on 14-19 May 2022 are shown in the tables.

Although the pH values were within the range of drinking water quality standards for all sites, high salinity levels (Electrical Conductivity EC and Total Dissolved Solids TDS) were recorded at Mbhedle, A hi tirheni Mqekwa and Duvadzi, mainly due to elevated Na and Cl. High NO<sub>3</sub> levels were recorded at Mbhedle, Mayephu, Mzilela (borehole H14-0022), A hi tirheni Mqekwa and Muyexe, above the legally required standard for drinking water quality (<48.7 Mg L<sup>-1</sup> NO<sub>3</sub>). The borehole at Mbhedle also displayed elevated NO<sub>2</sub> (6.698 mg/L). Total Organic Carbon (TOC) levels were within the standard drinking water quality range.

In comparison with the previous sampling campaign in May 2022, the elevated salinity values at Mbhedle, A hi tirheni Mqekwa farm and Duvadzi farm were confirmed. The elevated NO<sub>3</sub> at Mbhedle, Mayephu (borehole H14-1815), Mzilela, A hi tirheni Mqekwa and Muyexe were also confirmed due to the proximity of villages (draining water from villages). The spike of 205 mg L<sup>-1</sup> NO<sub>3</sub> concentration at borehole H14-1815 in Mayephu was confirmed due to the vicinity of an animal kraal. By far the best water quality source is the water retained in the sand alluvial aquifer of the Molototsi River (Nhlambeto farm at Dzumeri). This confirms previous results from the previous sampling campaign in May 2022. All parameters were within the standard limits, including colour. In general, the findings confirmed the need for groundwater treatment at sources for drinking water purpose. For agricultural purposes, water quality is fit to marginally fit for water use. The risk of salinization should be monitored at all sites.

## Water Sources for the GLSCR project sites

Village	Site	Water requirements		Source of water	Coordinates		Duration	Purpose
		(m <sup>3</sup> d <sup>-1</sup> )	(m <sup>3</sup> a <sup>-1</sup> )		Latitude	Longitude		
<b>Mbhedle</b>	Village population = 1230	30.8*	11242	Borehole in village, not recorded	-	-	3 years	<b>Drinking water.</b> No bulk water supply, villagers have to walk up to 0.7 km to collect water. Site proposed by community members.
<b>Mayephu</b>	Village population = 1940	48.5*	17702.5	Borehole No. H14-1815	-23.589623°	30.778480°	3 years	<b>Drinking water.</b> Emergency intervention linked to bulk water supply. Borehole and reservoir are established.
				Borehole No. H14-1818	-	-		
<b>Mzilela</b>	Village population = 1150	28.8*	14162	Borehole in village	-23.592869°	30.17120°	3 years	<b>Drinking water.</b> Bulk water supply is seldom available due to water shortage (once per month).
<b>Matsotsosela</b>	Village population = 2300	57.5*	20987.5	Borehole No. H14-0026	-23.60106°	30.829530°	3 years	<b>Drinking water.</b> No bulk water supply. Boreholes are established. Diesel expenses subsidized by local government are extremely high. Community operator is very committed.
				Borehole No. H14-0025	-23.600749°	30.825683°		
<b>Dzumeri</b>	Nhlambeto farm	58.9**	21863.5	Non-perennial river sand	-23.561512°	30.701696°	3 years	<b>Drinking water + emerging farm.</b> Emerging farmer was recently asked to stop farming by other water users due to drop in groundwater level.
<b>Dzumeri</b>	Ngamba farm	33.9	12373.5	Borehole not numbered	-23.591533°	30.706566°	3 years	<b>Emerging farm.</b> Pressure head is too low with the current pumping system.
<b>Dzumeri (Daniel Ravalela)</b>	A hi tirheni Mqekwa farm	33.9	12373.5	Borehole No. H14-1699	-23.57025°	30.65841°	3 years	<b>Emerging farm.</b> Well established. Electricity bills are very high.
				Borehole No. H14-1700	-23.57094°	30.65878°		
<b>Loloka</b>	Duvadzi farm	33.9	12373.5	Borehole No. H14-1703	-23.56712°	30.81966°	3 years	<b>Emerging farm.</b> Well established. Groundwater can also be abstracted from adjacent non-perennial river sand.
<b>Muyexe</b>	Muyexe community project	33.9	12373.5	Borehole not numbered	-23.187820°	30.911963°	3 years	<b>Emerging farm.</b> Rehabilitation of cooperative by Limpopo Department of Agriculture is planned.

Table 2: GLSCR Water Source for project sites

## Groundwater sample analyses for all water sources

Analysis	Mbhedle	Mayephu H14-1815	Mzilela H14-0022	Nhlambeto farm	Ngamba farm	A hi tirheni Mqekwa farm H14-1700	Duvadzi farm H14-1702	Muyexe farm	SANS 241
EC (µS/cm) (25°C)	2455	1586	1096	196	1533	2683	3556	1053	≤ 1700
pH (25°C)	7.53	7.06	7.07	7.92	7.01	7.21	7.36	7.54	≥ 5 and ≤ 9.7
TDS (ppm) @ 25°C	1228	793	548	98	767	1342	1778	527	≤ 1200
Colour (Hazen)	0.3	0.0	0.0	6.3	0.0	0.0	0.0	0.0	< 15
F (mg/L)	0.439	0.435	0.205	0.141	0.452	0.443	0.678	0.232	≤ 1.5
Cl (mg/L)	472.705	128.466	117.984	6.497	277.122	668.842	1026.835	62.029	≤ 300
SO <sub>4</sub> (mg/L)	44.114	71.668	29.832	3.544	28.093	46.311	83.111	24.966	≤ 500 (health) ≤ 250 (aesthetic)
PO <sub>4</sub> (mg/L)	n.d	n.d	n.d	Below calibration standard	Below calibration standard	n.d	Below calibration standard	Below calibration standard	-
NO <sub>2</sub> (mg/L)	6.698	n.d	n.d	n.d	n.d	n.d	n.d	n.d	≤ 2.96
Br (mg/L)	1.264	0.627	0.448	Below calibration standard	0.609	1.387	2.611	0.313	-
NO <sub>3</sub> (mg/L)	62.825	204.651	100.388	4.542	24.799	73.812	27.22	74.728	≤ 48.7
Li (mg/L)	0.025	0.012	0.003	n.d.	0.009	0.026	0.018	Below calibration standard	-
Na (mg/L)	359.952	77.172	72.004	12.883	153.405	242.848	338.291	46.093	≤ 200
NH <sub>4</sub> (mg/L)	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	≤ 1.5
K (mg/L)	11.663	1.269	1.435	1.926	2.393	2.771	11.425	0.583	-
Mg (mg/L)	90.863	101.797	53.733	3.617	74.068	129.812	182.351	71.137	-
Ca (mg/L)	81.935	135.446	67.533	9.435	87.14	164.636	176.275	63.648	-

Table 3: Results of the laboratory analyses of groundwater samples collected from all water sources at the pilot sites on 26-31 October 202



Analysis	Mbhedle	Mayephu H14-1816	Mayephu H14-1815	Mzilela	Matsotsosela	Nhlambeto farm	Ngamba farm	A hi tirheni Mqekwa farm H14-1700	Duvadzi farm H14-1702	Muyexe farm	SANS 241
EC (µS/cm) (25°C)	2500	1286	1566	1046	2032	279.7	2691	2672	1941	1045	≤ 1700
pH (25°C)	7.286	7.171	6.958	7.928	7.335	7.275	6.857	7.16	7.569	7.768	≥ 5 and ≤ 9.7
TDS (ppm) @ 25°C	1336	523	1016	1250	783	140	643	971	1346	523	≤ 1200
Colour (Hazen)	1.7	1.4	0	0.1	3.3	69.5	1.7	0	0.2	0	< 15
F (mg/L)	0.592	0.598	0.582	0.300	0.968	0.14	0.547	0.596	1.017	0.321	≤ 1.5
Cl (mg/L)	475.706	110.216	125.116	87.419	319.65	16.741	678.633	632.826	463.861	61.275	≤ 300
SO <sub>4</sub> (mg/L)	44.819	46.085	74.881	31.299	34.524	4.674	36.347	46.188	40.470	24.318	≤ 500 (health) ≤ 250 (aesthetic)
PO <sub>4</sub> (mg/L)	n.d	<LCS	n.d	n.d	n.d	<LCS	n.d	n.d	n.d	n.d	-
NO <sub>2</sub> (mg/L)	n.d	.	n.d	n.d	.	n.d	.	n.d	n.d	n.d	≤ 2.96
Br (mg/L)	1.303	0.420	0.634	0.427	0.913	0.069	1.408	1.506	1.411	0.302	-
NO <sub>3</sub> (mg/L)	73.867	32.588	212.745	77.846	34.99	0.531	31.269	68.950	9.428	70.932	≤ 48.7
Na (mg/L)	357.126	69.707	77.438	47.791	335.407	20.154	240.526	217.145	211.894	49.142	≤ 200
NH <sub>4</sub> (mg/L)	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	n.d.	≤ 1.5
K (mg/L)	12.138	2.937	1.984	2.289	4.057	3.797	6.909	6.048	9.253	1.407	-
Mg (mg/L)	93.167	84.701	100.099	85.141	64.826	8.600	133.473	137.232	89.329	79.151	-
Ca (mg/L)	85.097	100.382	137.242	52.957	71.867	20.666	161.796	174.406	93.887	66.138	-
TOC [mg/l]	16.519	15.347	15.533	9.214	15.663	6.629	16.181	15.674	8.467	8.889	≤ 10

Table 4: Results of the laboratory analyses of groundwater samples collected from all water sources at the pilot sites on 15-16 May 2022


Analysis	Nhlambeto farm	Ngamba farm	A hi tirheni Mqekwa farm AHM6	Duvadzi farm H14-1702	Muyexe farm	SANS 241
EC (µS/cm) (25°C)	770	3044	991.8	2136	1054	≤ 1700
pH (25°C)	7.144	6.528	7.588	7.288	6.954	≥ 5 and ≤ 9.7
TDS (ppm) @ 25°C	385	1522	495.9	1068	527	≤ 1200
Colour (Hazen)	6.4	0	0	2.8	0.5	< 15
F (mg/L)	0.132	0.574	0.791	1.061	0.356	≤ 1.5
Cl (mg/L)	114.612	876.824	24.54	525.214	66.463	≤ 300
SO <sub>4</sub> (mg/L)	13.826	45.924	10.852	55.364	24.882	≤ 500 (health) ≤ 250 (aesthetic)
PO <sub>4</sub> (mg/L)	n.d	n.d	n.d	Below calibration standard	Below calibration standard	-
NO <sub>2</sub> (mg/L)	n.d	n.d	n.d	n.d	n.d	≤ 2.96
Br (mg/L)	0.297	1.639	0.17	1.466	0.346	-
NO <sub>3</sub> (mg/L)	2.106	60.464	2.368	16.16	69.526	≤ 48.7
Na (mg/L)	77.242	275.105	138.067	244.152	55.269	≤ 200
NH <sub>4</sub> (mg/L)	Below calibration standard	n.d	n.d	n.d	n.d	≤ 1.5
K (mg/L)	6.335	11.475	4.998	10.261	1.069	-
Mg (mg/L)	17.697	145.058	33.308	98.492	73.848	-
Ca (mg/L)	45.39	166.91	47.096	95.499	63.524	-
TOC [mg/l]	8.76	13.94	13.89	13.77	12.60	≤ 10
Al (µg/L)	<LOQ	<LOQ	<LOQ	<LOQ	<LOQ	≤ 300
Mn (µg/L)	262.25	115.14	241.80	24.32	<LOQ	≤ 400 (health)

Analysis	Nhlambeto farm	Ngamba farm	A hi tirheni Mqekwa farm AHM6	Duvadzi farm H14-1702	Muyexe farm	SANS 241
						≤ 100 (aesthetic)
Fe (µg/L)	2.98	1.91	3.84	2.68	3.31	≤ 2000 (health)
						≤ 300 (aesthetic)
Cu (µg/L)	0.75	1.49	1.65	<LOQ	<LOQ	≤ 2000
Cd (µg/L)	<LOQ	0.09	<LOQ	<LOQ	<LOQ	≤ 3
Zn (µg/L)	1.14	2.07	3.67	0.30	30.44	≤ 5000
As (µg/L)	<LOQ	<LOQ	<LOQ	0.20	7.00	≤ 10


Table 5: Results of the laboratory analyses of groundwater samples collected from all water sources at the pilot sites on 4-8 September 2023.

## Agricultural Cooperative Water Supply Drawings:


## 1. Hybrid Solar System

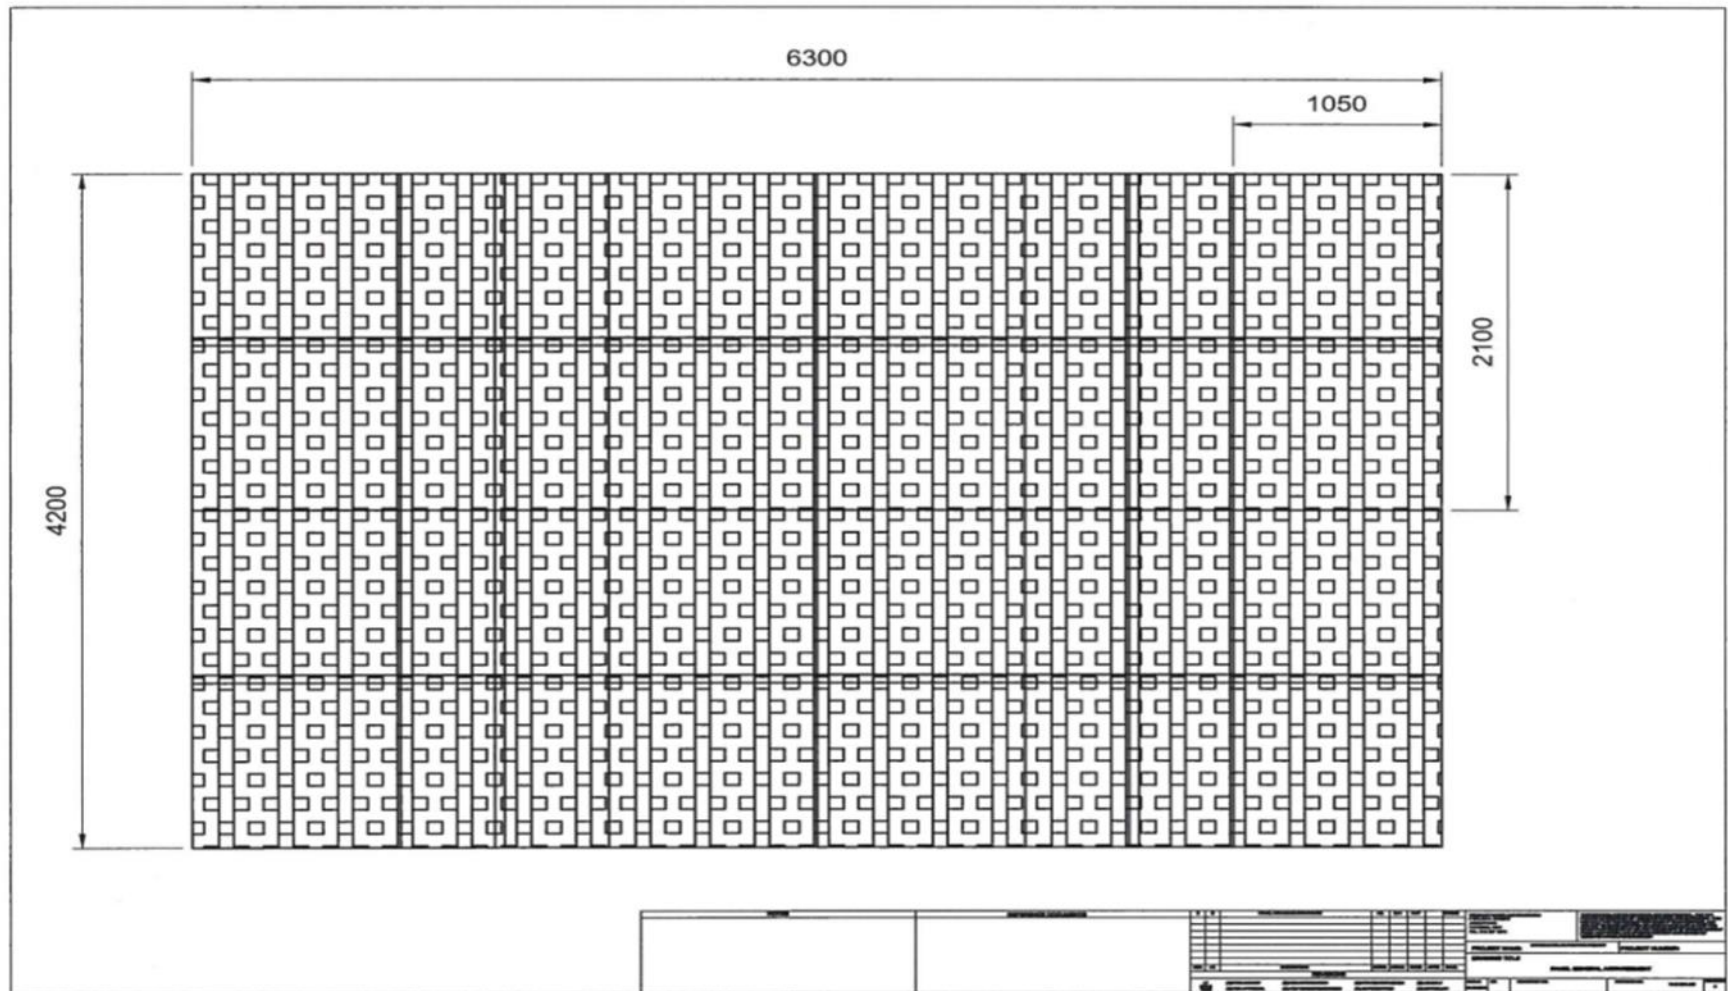




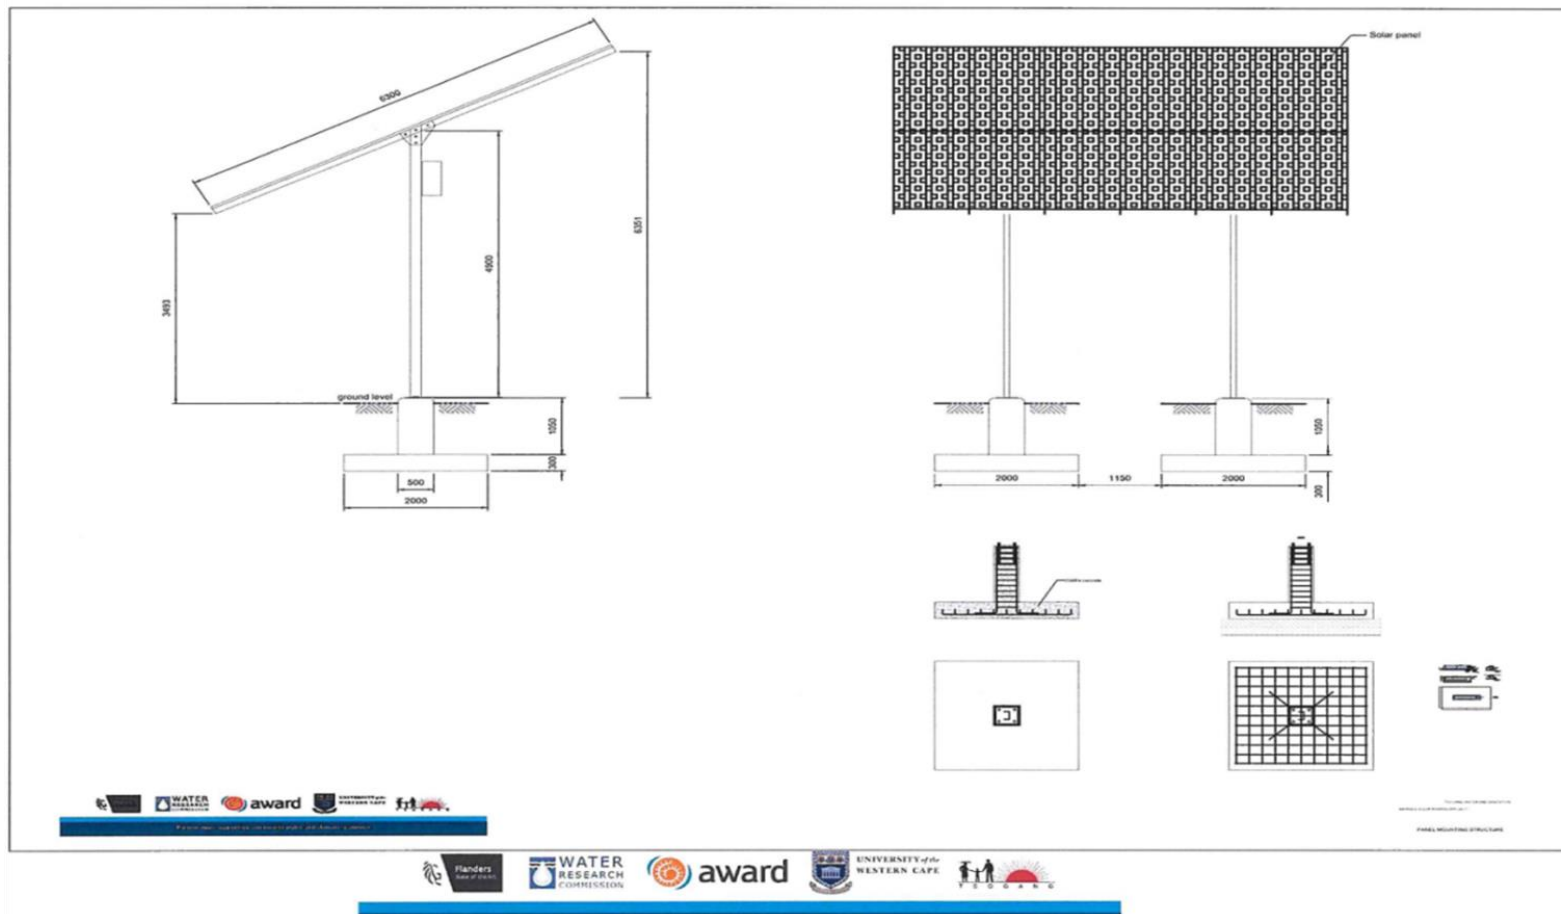


## 2. Fencing (Storage and Solar)

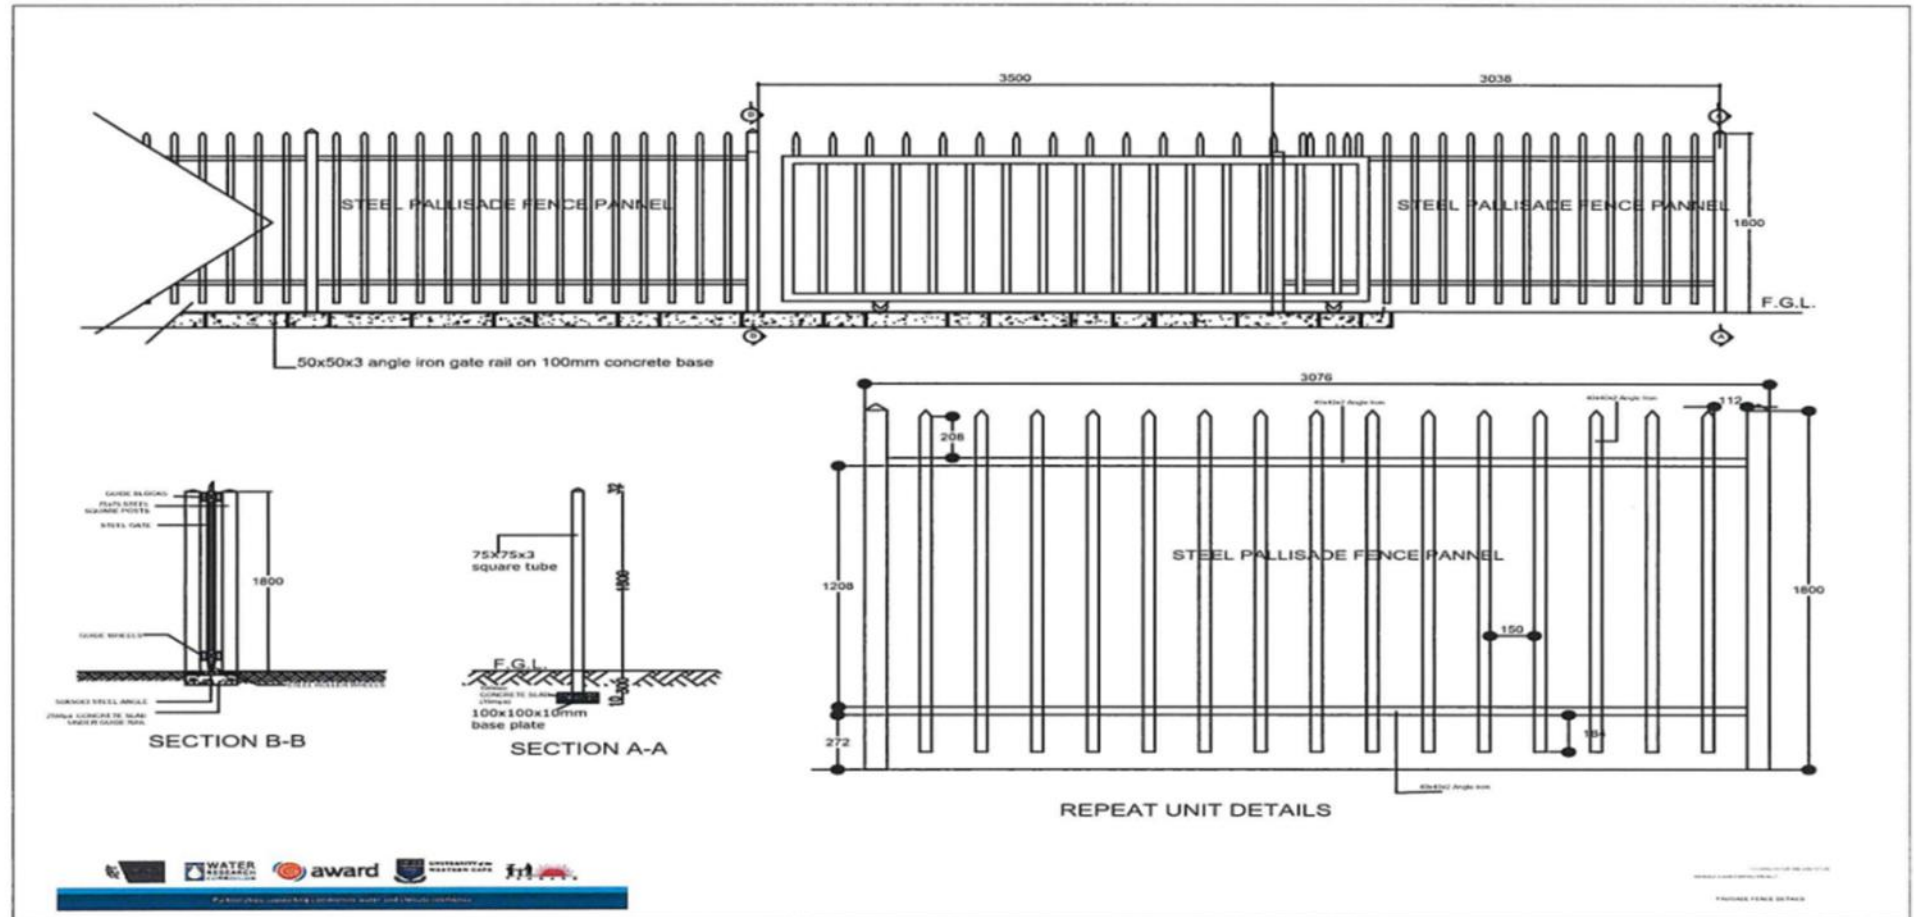

### 3. Water Storage

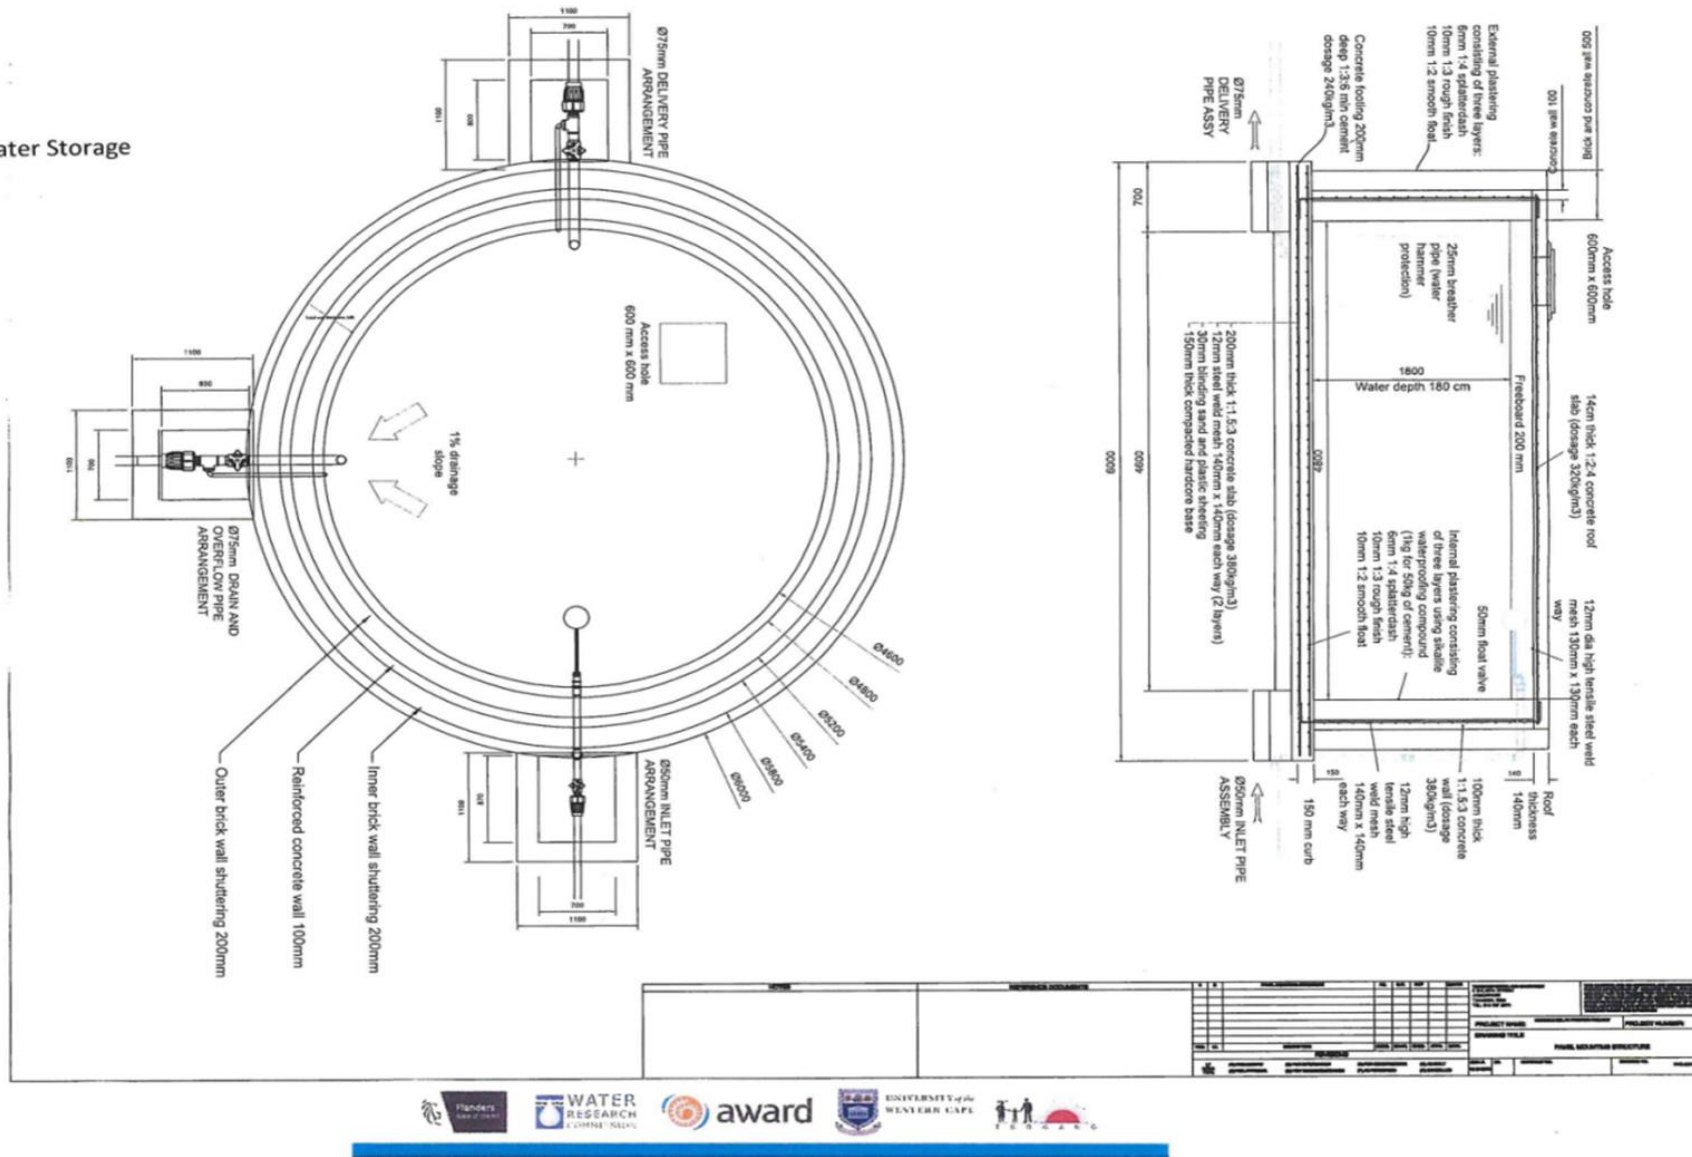

#### 4. Borehole testing/ Equipping

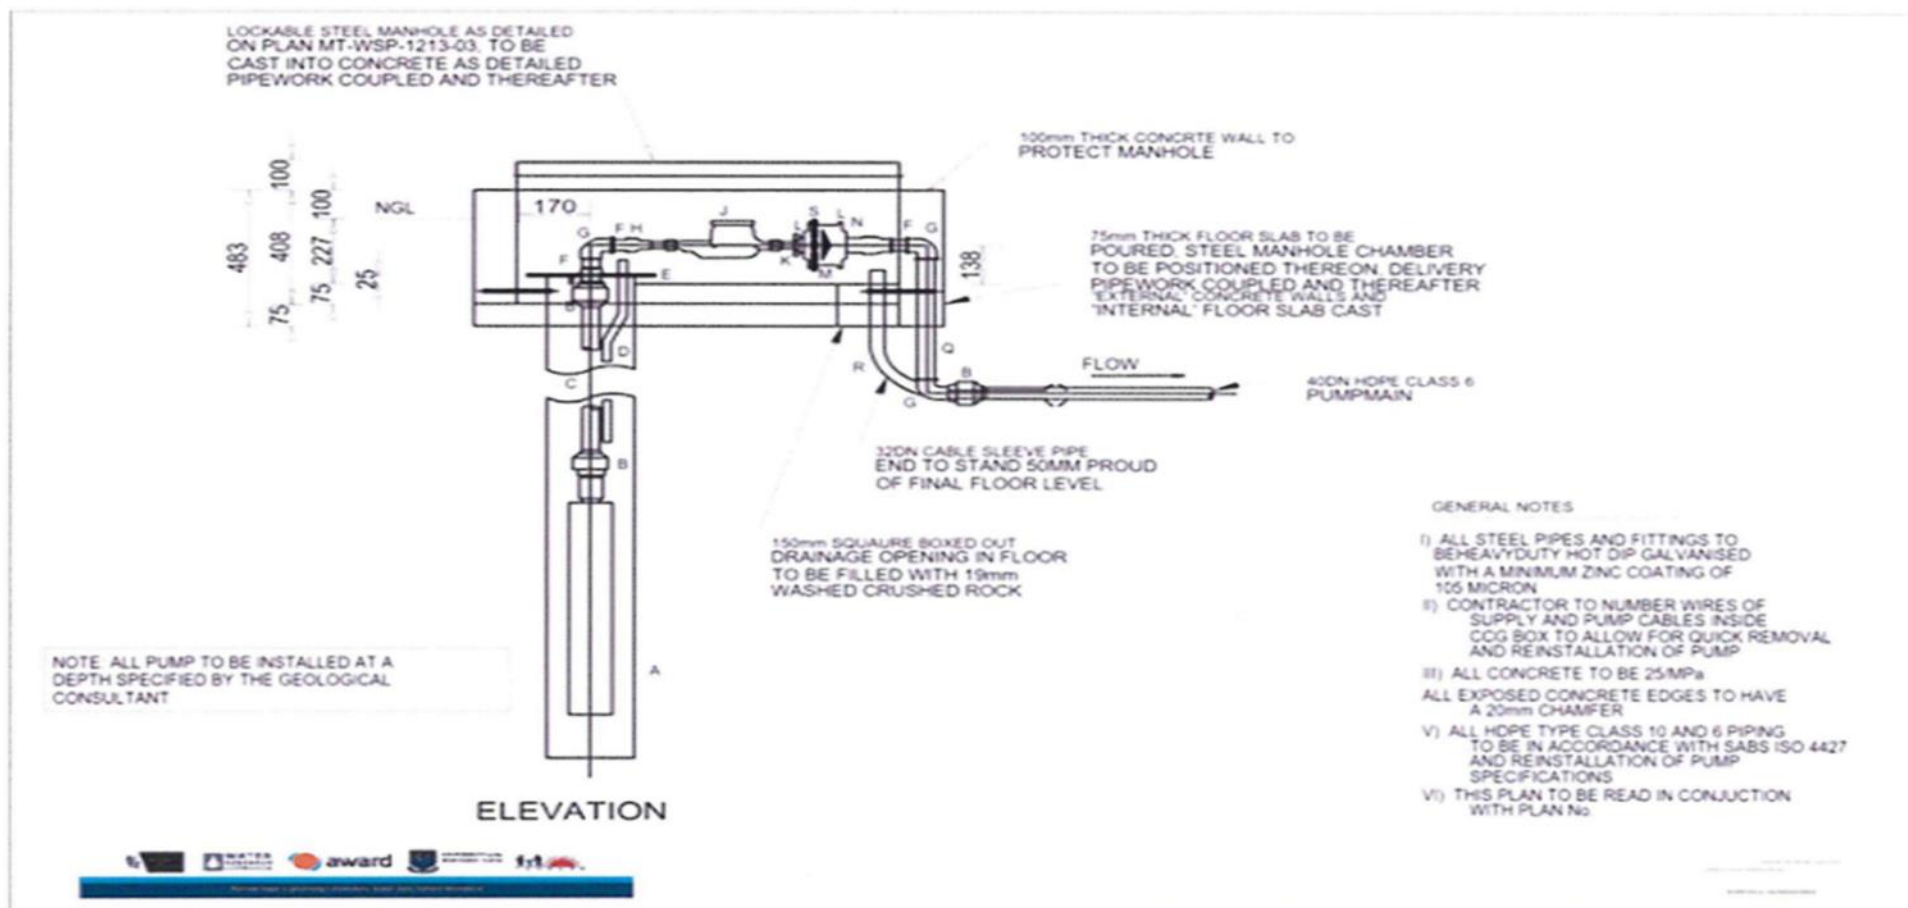

## 5. Drip irrigation layout



Legend:

	Storage		Borehole		Usage node		Rising main		Reticulation		Solar
--	---------	--	----------	--	------------	--	-------------	--	--------------	--	-------



# GLSCRIP

## GIYANI LOCAL SCALE CLIMATE RESILIENCE PROGRAMME



Government  
of Flanders



award



UNIVERSITY of the  
WESTERN CAPE



GLSCRIP is a community advised and LED programme demonstrating climate adaptive responses and solutions for improved water utilisation in the Giyani Municipal area. It is a partnership programme funded by the Government of Flanders, led by the Water Research Commission with partners Tsogang Water and Sanitation (Tsogang), Association for Water and Rural Development (AWARD) and the University of the Western Cape (UWC). The Programme aims to develop, research and demonstrate, practical water-linked climate adaptation solutions at local, community and catchment scale for the benefit of 5000 Giyani community members in order to improve water utilisation, community resilience and local economic growth for local and women-led enterprises.